


Fixed Fire Equipment Specifications

Applies to equipment both on columns and walls



Fira Barcelona


Gran Via Venue

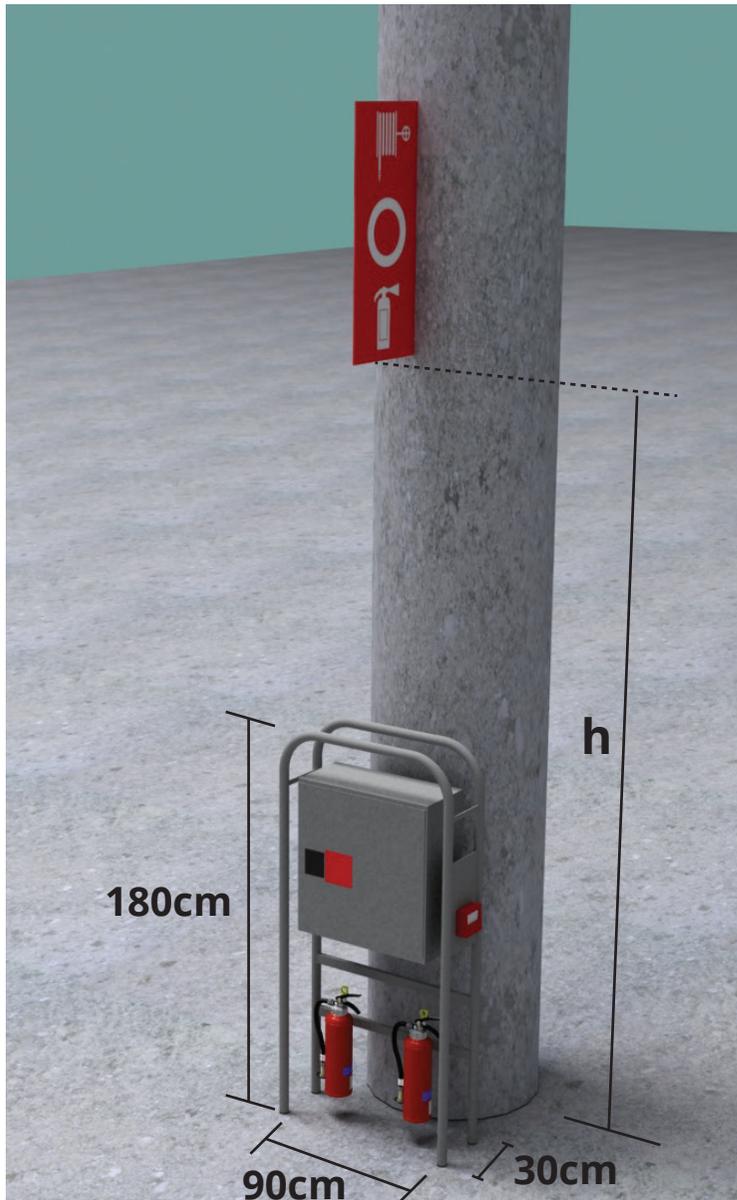

Note that the fire extinguisher equipment can only be cladded if all the equipment remains accessible at all times.


Hall	h (cm)
Hall 1	295
Hall 2	*
Hall 3	490
Hall 4	590
Hall 5	295
Hall 6	545
Hall 7	295
Hall 8	350
Hall 8.1	349

* Hall 2 does not have columns in the exhibition area

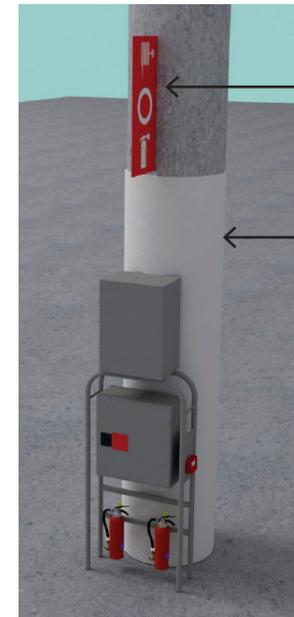

The fire signage can be removed temporarily. Please contact Fira in order to do so. The exhibitor is responsible for replacing the obstructed or removed sign with a different sign, as long as it complies with EU regulation.

A vinyl can reach up to the upper fire sign or if the sign is removed, up to the maximum build height allowed.

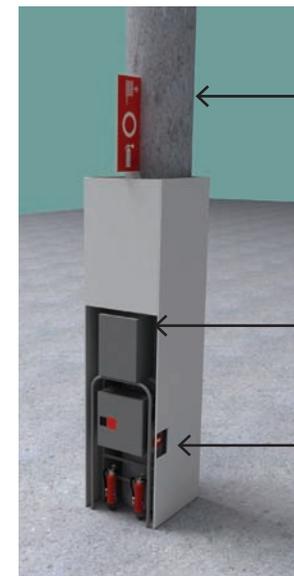

The cladding cannot cover the upper signage. It could be removed temporarily. Please contact Fira in order to do so. The exhibitor is responsible for replacing the obstructed or removed sign with a different sign, as long as it complies with EU regulation.

Some of the fire equipment in Halls 3, 4 and 6 include fixed switchboards. Check floorplans and pictures of the halls in order to see if the specific column includes it or not. The switchboards can be cladded but need to be accessible during build up and dismantling to other exhibitors.

The emergency button needs to be accessible through an opening of minimum 15 X 15cm.